

TITLE: INTELL-LIFT PRO 125 GAL RH

DOORS - SAME SIDE WITH GATE
24"W x 24"D x 24"H 125 lb. Capacity

| REV | DESCRIPTION | DATE | BY |
|-----|-------------|------|----|
| | | | |
| | | | |

STOPS: 2 IN-LINE OPP.
 OPENINGS: 2 @ LOWER, UPPER
 TRAVEL: T.B.O.

| | | |
|----------------|---|--|
| HOISTWAY DOORS | <input checked="" type="checkbox"/> SAME SIDE | <input checked="" type="checkbox"/> DRYWALL CONSTRUCTION |
| | <input type="checkbox"/> SLIDE-UP | <input type="checkbox"/> MASONRY CONSTRUCTION |
| | <input type="checkbox"/> FLOOR LOADING | <input type="checkbox"/> PLAIN STEEL - PRIMED |
| | <input type="checkbox"/> STAINLESS SILLS | <input checked="" type="checkbox"/> STAINLESS STEEL - #4 |
| | <input type="checkbox"/> FUSIBLE LINK | <input type="checkbox"/> COUNTER LOADING |

| | |
|--|---|
| <input checked="" type="checkbox"/> HG-1 SINGLE CONTACT DOOR LOCK & CONTACT NEMA 1 | <input checked="" type="checkbox"/> EMERGENCY RELEASE |
| <input checked="" type="checkbox"/> HG-2 DOUBLE CONTACT INTERLOCK NEMA 1 | <input type="checkbox"/> NON-PLUGGABLE INTERLOCK |

JAMB MOUNTED 24V PUSHBUTTON STATIONS:



| | |
|--|--|
| <input type="checkbox"/> NON-ILLUMINATED | <input type="checkbox"/> ILLUMINATED |
| BUTTONS: <input checked="" type="checkbox"/> UP <input checked="" type="checkbox"/> DOWN | <input type="checkbox"/> 1 <input type="checkbox"/> 2 <input type="checkbox"/> 3 |
| LIGHTS: <input type="checkbox"/> CAR HERE | <input type="checkbox"/> IN USE |
| <input type="checkbox"/> HEADER MOUNTED 24V CAR ARRIVAL LIGHTS | |

| | |
|-------------|----------------------|
| CAR GATE | ALUMINUM |
| ACCESS DOOR | PLAIN STEEL |
| | BY: Nationwide Lifts |
| | STAINLESS STEEL - #4 |
| | NONE / BY OTHERS |

HOISTWAY TO BE BUILT BEFORE DUMPWATER IS INSTALLED EXCEPT THE WALLS ARE TO BE OMITTED WHERE HOISTWAY DOORS OCCUR UNTIL THE DUMPWATER IS INSTALLED & HOISTWAY DOORS ARE SET IN PLACE

POWER SUPPLY: A LOCKABLE FUSED DISCONNECT MUST BE PROVIDED IN ACCORDANCE WITH LOCAL ELECTRICAL CODES. THE SUPPLY MUST BE A 115V, 20A DEDICATED CIRCUIT.

DOORS: DOORS MUST MEET LOCAL FIRE CODE. INTERLOCK DEVICES ARE PROVIDED AND MUST BE MOUNTED TO DOORS AS DIRECTED IN THE INSTALLATION GUIDE.

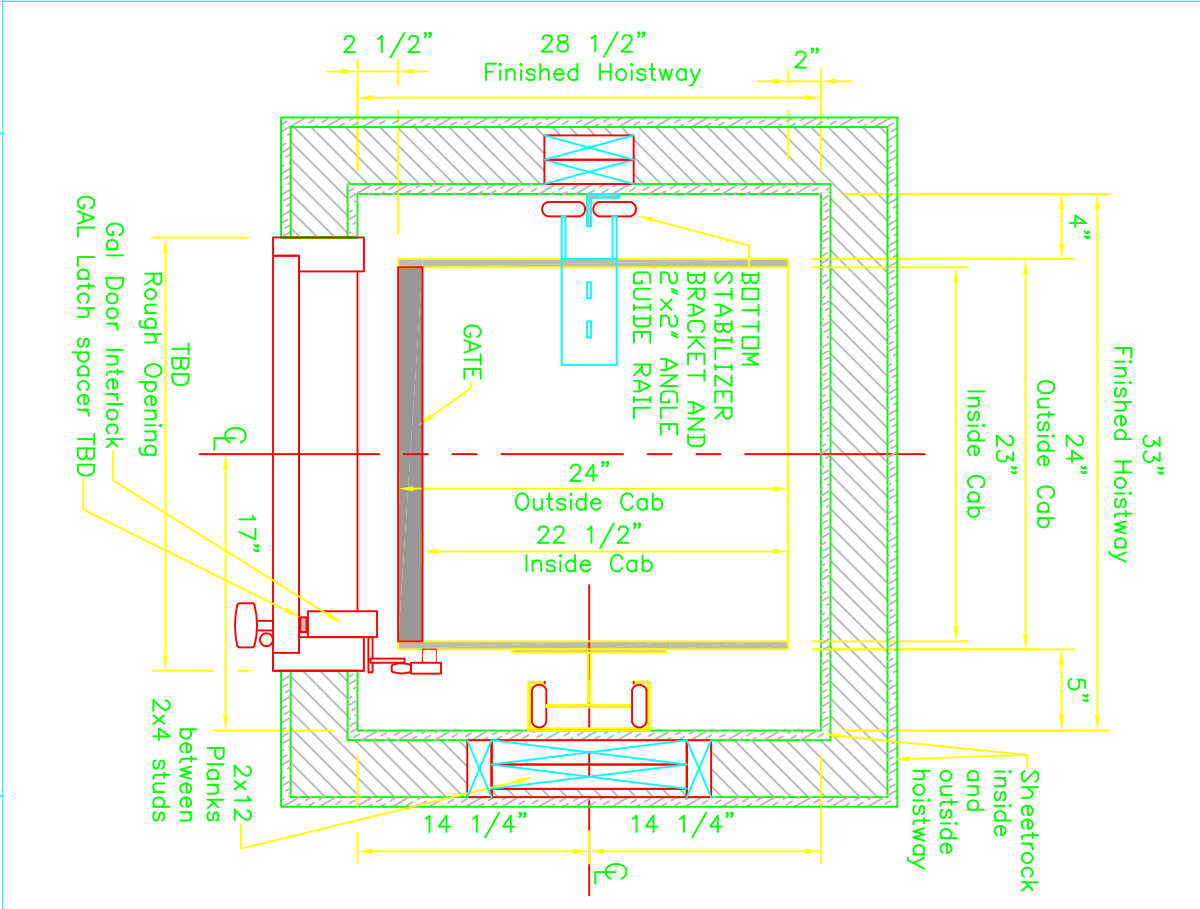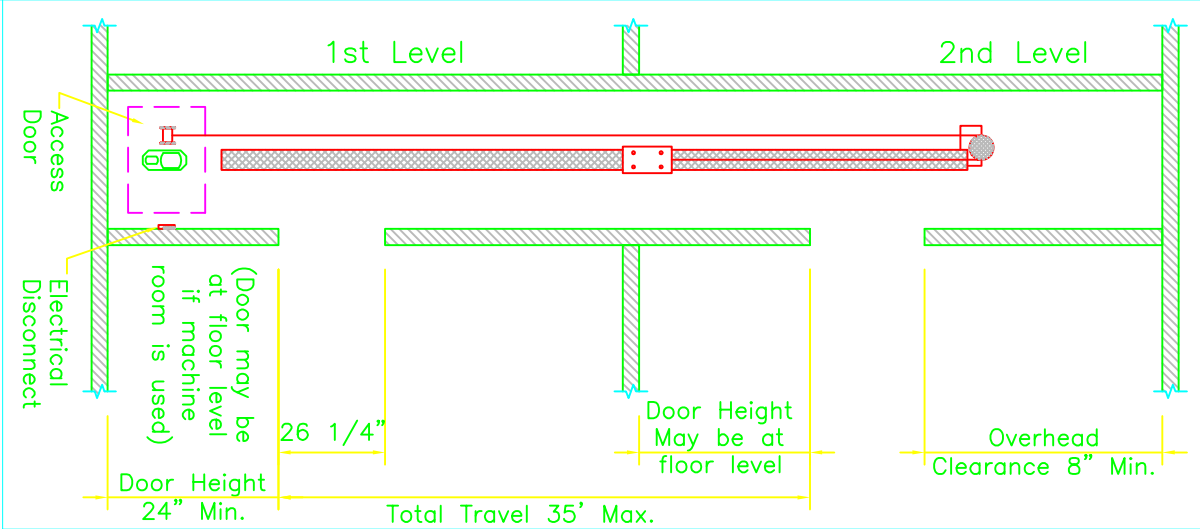

HOISTWAY: THE HOISTWAY MUST BE IN ACCORDANCE WITH "SAFETY CODE FOR ELEVATORS AND ESCALATORS" (ASME A17.1) AND ALL STATE AND LOCAL CODES.

PLUMB HOISTWAY: DUE TO CLOSE RUNNING CLEARANCES OWNER/AGENT MUST ENSURE THAT HOISTWAY IS PLUMB, AND SQUARE AND IS IN ACCORDANCE WITH DIMENSIONS ON THESE DRAWINGS.

REINFORCED WALL: THE RAIL WALL MUST BE REINFORCED WITH DOUBLE 2X12 PLANKS AS SHOWN ON THE DRAWINGS. THE MACHINE AND RAIL SYSTEM REQUIRES THESE 2X12 PLANKS FOR SUPPORT.

MACHINE ROOM: MACHINE ROOM MAY BE LOCATED WITHIN THE HOISTWAY ON THE BOTTOM FLOOR OR IN A CLOSET ADJACENT TO THE HOISTWAY (BEHIND THE RAIL WALL). THE MACHINE ROOM MUST HAVE A LOCKABLE ACCESS DOOR. THIS DOOR MUST REMAINED LOCKED AT ALL TIMES.

APPROVED BY: _____

OPENING: SAME SIDE

DWG NO. -----

CUSTOMER: _____

SHIP TO: _____

JOB NAME: _____

DATE APPROVED: _____

SHEET 1 OF 1

DATE: 10/26/09